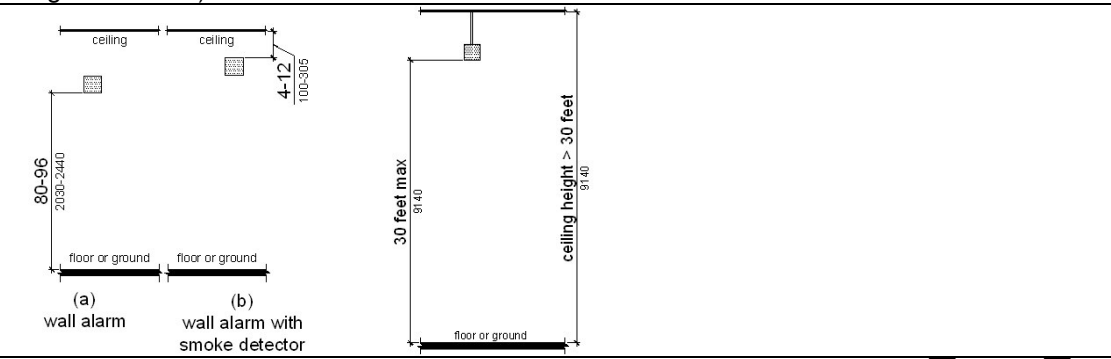
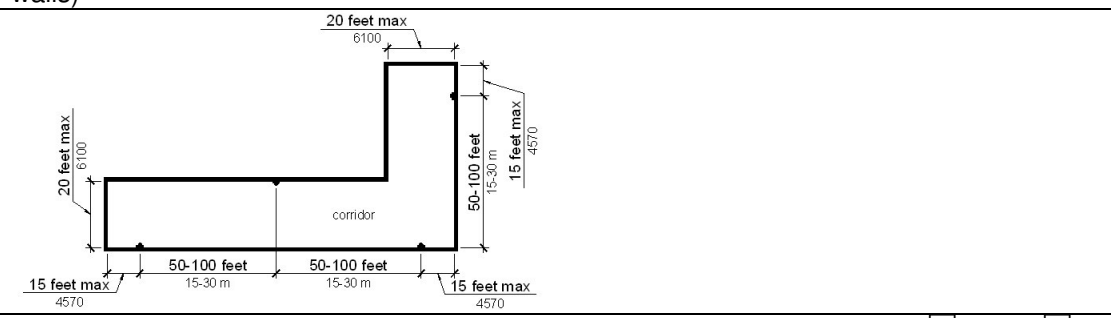
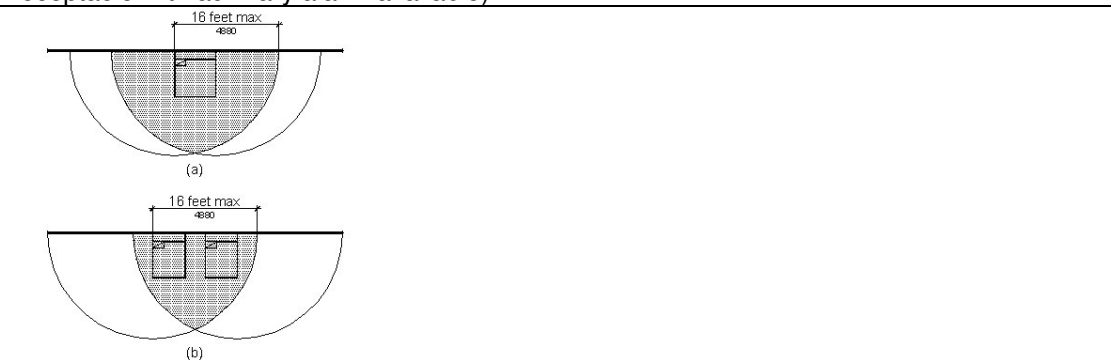


ELEMENT		COMPLIES (or NA)	DOES NOT COMPLY
ALARMS			
	Are emergency warning systems provided [YES] or [NO]		
APPLICABLE	If emergency warning systems are provided, they shall include both audible and visual alarms complying with this section.	<input type="checkbox"/>	<input type="checkbox"/>
	When required, at a minimum, visual alarms shall be provided in restrooms, meeting rooms, hallways, lobbies, and common use areas	<input type="checkbox"/>	<input type="checkbox"/>
ALARMS	Sound (exceeds prevailing equivalent sound level in space)	<input type="checkbox"/>	<input type="checkbox"/>
	Lamp (strobe type, clear or white)	<input type="checkbox"/>	<input type="checkbox"/>
	Mounting (lowest of: 80" above highest fl. level in space or within 6" below ceiling) (Note: New ADAAG mounting height range illustrated in diagrams below)	<input type="checkbox"/>	<input type="checkbox"/>
Mounting ht.			
	Spacing (max. 50' from signal within space or room or corridor)	<input type="checkbox"/>	<input type="checkbox"/>
	Spacing in large open rooms (max. 100' between units at perimeter walls)	<input type="checkbox"/>	<input type="checkbox"/>
Mounting location			
	Sleeping rooms (visual alarm connected to bldg. system, or 110V receptacle with auxiliary alarm available)	<input type="checkbox"/>	<input type="checkbox"/>
Accessible Sleeping rooms			
	Visible notification devices (phone call, door bell connected to bldg. System)		
	Telephones (shall have volume control, electrical outlet within 48" for TTY)		