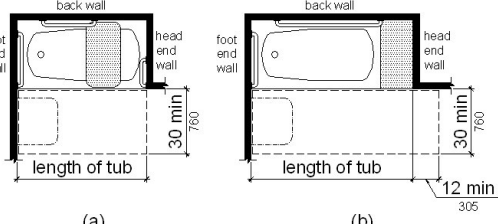
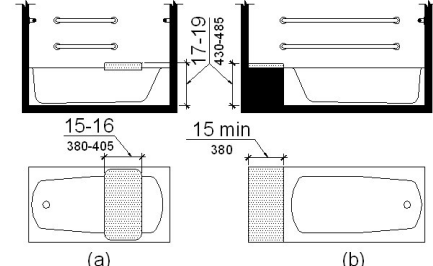
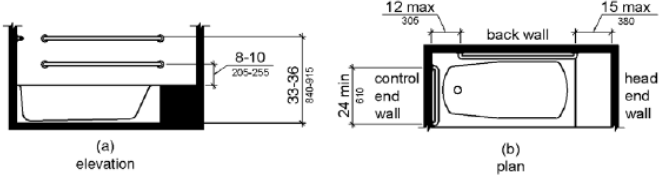
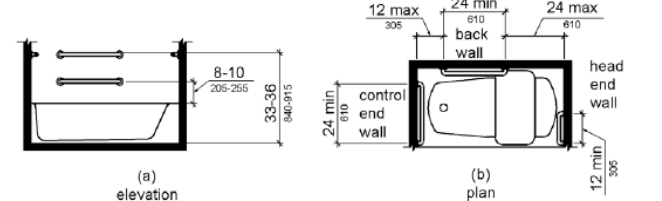
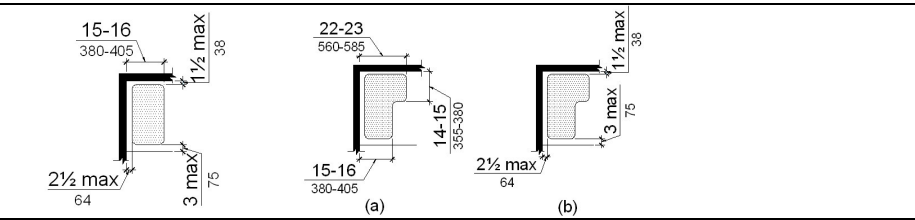

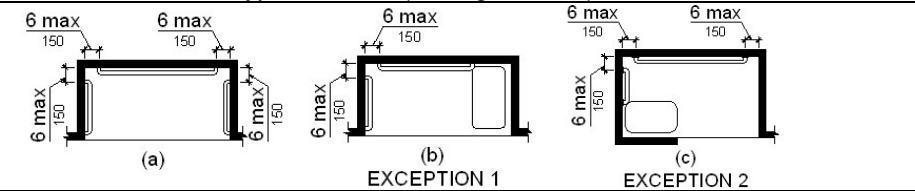
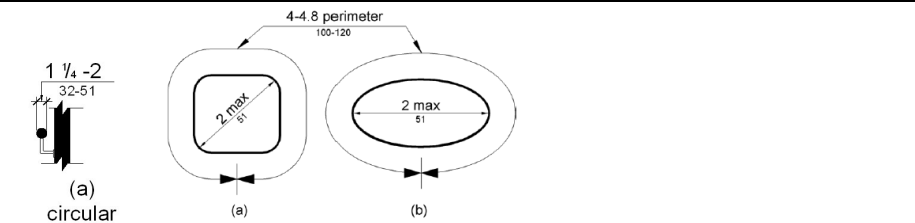
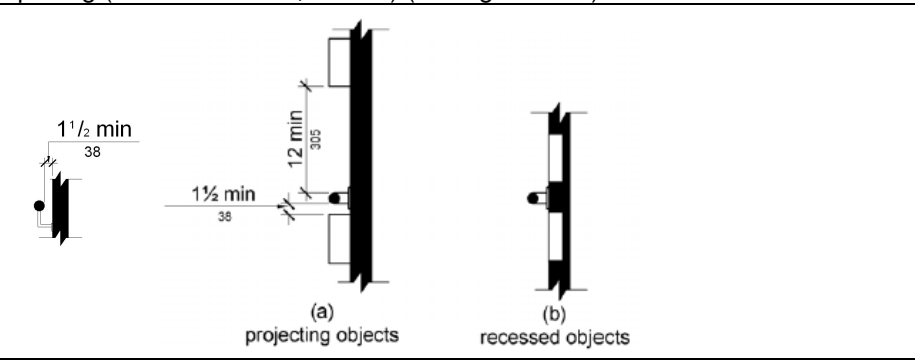
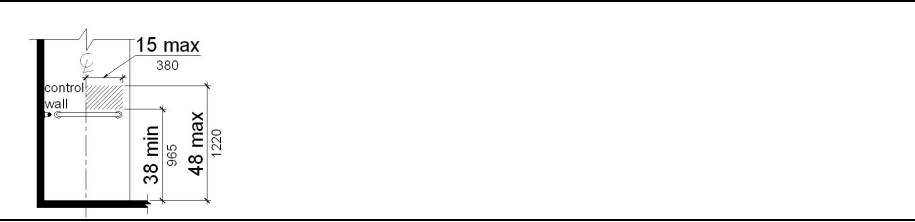
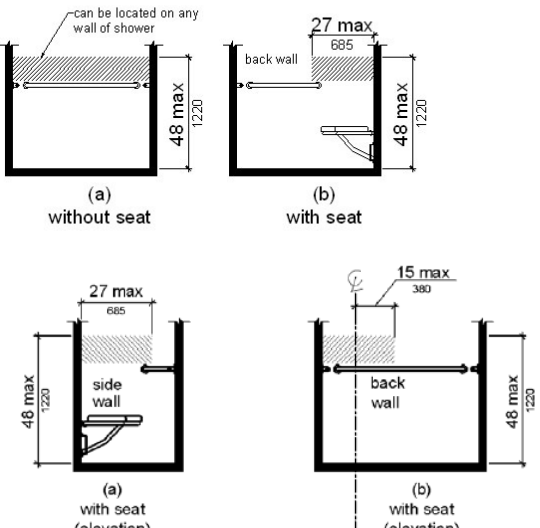


| ELEMENT | | COMPLIES (or NA) | DOES NOT COMPLY |
|--|--|--|--|
| BATHTUBS AND SHOWERS (typically found as part of a locker room) | | | |
| APPLICABLE | <p>If shower or bathing facilities are provided, then each such public or common use shower bathtub facility shall comply with this section. In addition, public and common use areas adjacent to and serving the shower room shall comply with all other applicable accessibility sections of this checklist.</p> <p>If both showers and bathtubs are provided, than at least 1 shower or 1 bathtub shall comply with this section.</p> | | |
| SHOWER / TUB AREA | <p>Clear floor space (60" diameter unobstructed circle required; may overlap door swing, clear floor space at fixtures)</p> <p>Door swing (shall not swing into clear floor space for any fixture)</p> | <input type="checkbox"/> <input type="checkbox"/> | <input type="checkbox"/> <input type="checkbox"/> |
| BATHTUB Size and clearance | <p>Clear floor space (see figs. below)</p>  | <input type="checkbox"/> | <input type="checkbox"/> |
| Seat size and location | <p>Seat (removable seat; or permanent seat at head of tub)</p> <p>Bathtub seat (17 – 19" AFF; 15 – 16" deep; secure placement)</p>  | <input type="checkbox"/> <input type="checkbox"/> | <input type="checkbox"/> <input type="checkbox"/> |
| Grab bar location | <p>Grab bars (installed; or reinforcing installed for future installation)</p> <p>Grab bars for bathtubs with permanent seats (see figs. below)</p>  | <input type="checkbox"/> <input type="checkbox"/> | <input type="checkbox"/> <input type="checkbox"/> |
| Grab bar location | <p>Grab bars for bathtubs with removable seats (see figs. below)</p>  | <input type="checkbox"/> | <input type="checkbox"/> |
| | <p>Size (1-1/4 – 1-1/2" outside diameter; or equivalent gripping)</p> | <input type="checkbox"/> | <input type="checkbox"/> |

| ELEMENT | | COMPLIES (or NA) | DOES NOT COMPLY |
|--------------------|---|--------------------------|--------------------------|
| Size | <p>(a) circular</p> | | |
| Spacing | <p>Spacing (1-1/2" from wall; recess) (see figs. below)</p> <p>(a) projecting objects (b) recessed objects</p> | | |
| | Strength (shall permit vertical or horizontal force of 250#) | <input type="checkbox"/> | <input type="checkbox"/> |
| | Controls (control end wall, between rim and grab bar, between centerline and open end) | | |
| Control wall | | | |
| | Shower spray (min. 59" long hose with on/off spray control) | <input type="checkbox"/> | <input type="checkbox"/> |
| | Enclosure (shall not obstruct controls or transfer) | <input type="checkbox"/> | <input type="checkbox"/> |
| SHOWER | Transfer type (see figs. below) | <input type="checkbox"/> | <input type="checkbox"/> |
| Size and clearance | | | |
| | Roll-in type (see figs. below) | <input type="checkbox"/> | <input type="checkbox"/> |
| Size and clearance | | | |
| | Seat (folding or non-folding for transfer type; folding for roll-in type) | <input type="checkbox"/> | <input type="checkbox"/> |
| | Transfer shower seat (17 – 19" AFF; within 3" from entry side) | <input type="checkbox"/> | <input type="checkbox"/> |
| | Roll-in shower seat (folding; 17 – 19" AFF; within 3" from entry side) | <input type="checkbox"/> | <input type="checkbox"/> |

| ELEMENT | | COMPLIES (or NA) | DOES NOT COMPLY |
|-------------------|--|--------------------------|--------------------------|
| Shower seats |  | | |
| | Grab bars for transfer type showers (see figs. below) | <input type="checkbox"/> | <input type="checkbox"/> |
| Grab bar location |  | | |
| | Grab bars for roll-in type showers (see figs. below) | <input type="checkbox"/> | <input type="checkbox"/> |
| Grab bar location |  | | |
| | Size (1-1/4 – 1-1/2" outside diameter; or equivalent gripping) | <input type="checkbox"/> | <input type="checkbox"/> |
| Size |  | | |
| | Spacing (1-1/2" from wall; recess) (see figs. below) | | |
| Spacing |  | | |
| | Strength (shall permit vertical or horizontal force of 250#) | <input type="checkbox"/> | <input type="checkbox"/> |
| | Controls for transfer type showers (see figs. below) | <input type="checkbox"/> | <input type="checkbox"/> |
| Controls |  | | |
| | Controls for roll-in showers (see figs. below) | <input type="checkbox"/> | <input type="checkbox"/> |

| ELEMENT | COMPLIES (or NA) | DOES NOT COMPLY |
|---|--------------------------|--------------------------|
| <p>Controls</p>  | | |
| Shower spray (min. 59" long hose with on/off spray control) | <input type="checkbox"/> | <input type="checkbox"/> |
| Threshold (max. 1/2" high) | <input type="checkbox"/> | <input type="checkbox"/> |
| Enclosure (shall not obstruct controls or transfer) | <input type="checkbox"/> | <input type="checkbox"/> |

| | |
|--------------|---|
| TOILET ROOMS | If provided, complete TOILET ROOMS section |
|--------------|---|