
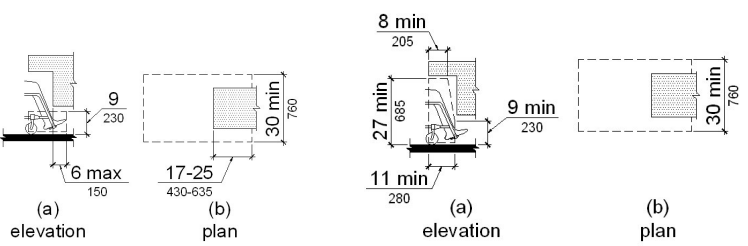


ELEMENT	COMPLIES (or NA)	DOES NOT COMPLY	
<b>DRINKING FOUNTAIN – WATER COOLER</b>			
APPLICABLE	<p>Where one drinking fountain is provided per floor, it shall serve both wheelchair users and people who have difficulty stooping or bending. (This may be accomplished with a “hi-lo” unit )</p> <p>If more than one drinking fountain is provide per floor, 50% shall be on an accessible route and comply with this section.</p>		
UNITS	Height (max. 36” AFF from floor to spout outlet for wheelchair user)	<input type="checkbox"/>	<input type="checkbox"/>
Spout ht.	Height (38” – 43” AFF from floor to spout outlet for standing person)	<input type="checkbox"/>	<input type="checkbox"/>
			
	Location (front of unit with near parallel water flow trajectory to front)	<input type="checkbox"/>	<input type="checkbox"/>
	Water flow (min. 4” above spout)	<input type="checkbox"/>	<input type="checkbox"/>
	Round or oval bowls (spout positioned within 3” of front of unit)	<input type="checkbox"/>	<input type="checkbox"/>
	Mounting (front or side near the front of the unit)	<input type="checkbox"/>	<input type="checkbox"/>
	Control operation (operable with one hand w/o pinching, turning of wrist; max. 5# of force)	<input type="checkbox"/>	<input type="checkbox"/>
	Wall and post mounted units (min. 27” AFF high knee space, min. 30” wide, min. 17” deep)	<input type="checkbox"/>	<input type="checkbox"/>
	Clear floor space (min. 30” x 48” for forward approach)	<input type="checkbox"/>	<input type="checkbox"/>
	Toe and knee clearance provided (see figs. below)	<input type="checkbox"/>	<input type="checkbox"/>
Toe and Knee Clearance			
	If knee space not provided (min. 30” x 48” with parallel approach req’d.)	<input type="checkbox"/>	<input type="checkbox"/>
Clear fl. Space and Spout Location	