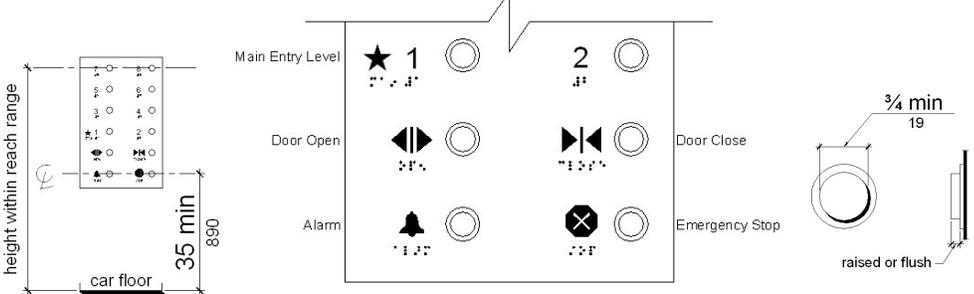


ELEMENT	COMPLIES (or NA)	DOES NOT COMPLY
---------	---------------------	--------------------

ELEVATORS		
------------------	--	--

WHERE REQUIRED	<p>One passenger elevator complying with this section shall serve each level of all multi-story buildings.</p> <p>Exceptions:</p> <ol style="list-style-type: none"> Not required in buildings less than 3 stories or less than 3,000 SF unless the building is a shopping center, office of a professional health care provider or a public transportation stop. Elevator pits, elevator penthouses, or mechanical rooms are exempt. Ramps or platform lifts may be used in lieu of an elevator. <p>A freight elevator shall be consider as meeting the requirements of this section unless it is the only elevator provided and it is used as a combination passenger and freight elevator.</p>		
----------------	--	--	--

ELEVATOR	<p>Operation (automatic, self-leveling cab to within 1/2" of floor level)</p> <p>Hall call button (42" AFF; visual signal to indicate call placed; min. 3/4" dia.; flush or raised)</p> <p>Hall lantern (visible; min. 72" AFF; min. 2 1/2" size; audible – sounds once for "up", twice for "down")</p>	<input type="checkbox"/>	<input type="checkbox"/>
Controls			
	<p>Hoistway characters (both jambs; 60" AFF; 2" high, raised 1/32", upper case, with Braille)</p> <p>Door opening device (door stop & reopen if obstructed between 5"-29" AFF; effective for 20 sec.)</p> <p>Door delay (shall remain fully open for min. 3 sec.)</p> <p>Door (36" min. clear opening, max. 1 1/4" clear space between landing and car platform)</p> <p>Floor plan (ability to enter, use controls and exit; acceptable dimensions illustrated below)</p>	<input type="checkbox"/>	<input type="checkbox"/>
Floor plan			
	<p>Floor surface (firm, stable, slip-resistant; carpet if provided, 1/2" max. pile, securely attached)</p> <p>Illumination (min. 5 foot-candles)</p>	<input type="checkbox"/>	<input type="checkbox"/>
CONTROLS	<p>Car control buttons (min. 3/4" dia.; flush or raised)</p> <p>Car control indicators (include Braille & character, left of button; 5/8"-2" high; w/visual signal; "star" to indicate main entry level)</p>	<input type="checkbox"/>	<input type="checkbox"/>

ELEMENT	COMPLIES (or NA)	DOES NOT COMPLY
<p>Controls</p> 		
<p>Emergency Communications (shall not be voice-only)</p>	<input type="checkbox"/>	<input type="checkbox"/>
<p>Emergency Controls (max. 48" AFF; identified with Braille & character; door to controls operable without tight pinching, twisting or turning of the wrist)</p>	<input type="checkbox"/>	<input type="checkbox"/>