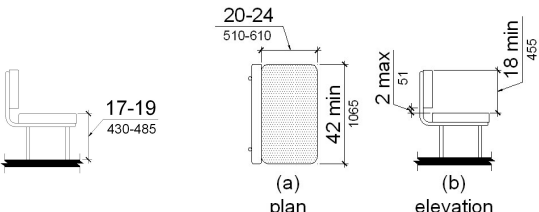


ELEMENT		COMPLIES (or NA)	DOES NOT COMPLY
<b>LOCKER AND DRESSING ROOMS</b>			
APPLICABLE	Locker and dressing rooms shall comply with this section. In addition, public and common use areas of locker and dressing rooms shall comply with all other applicable accessibility sections of this checklist.		
SIGNAGE	For room identification, complete <b>SIGNAGE</b> section		
DOOR	If provided, complete <b>DOOR</b> section		
ALARMS	If provided, complete <b>ALARMS</b> section		
ROOM	Clear floor space (60" diameter unobstructed circle required)	<input type="checkbox"/>	<input type="checkbox"/>
	Door swing (shall not swing into room unless clear floor space is provided outside arc of door swing)	<input type="checkbox"/>	<input type="checkbox"/>
BENCHES	Clear floor space (provided at end of bench and parallel to short axis)	<input type="checkbox"/>	<input type="checkbox"/>
	Height (17"-19" AFF to top of seat)	<input type="checkbox"/>	<input type="checkbox"/>
	Size (min. 42" long, 20" – 24" deep)	<input type="checkbox"/>	<input type="checkbox"/>
	Back support (provided or bench affixed to wall)	<input type="checkbox"/>	<input type="checkbox"/>
Benches			
	Accessible coat hooks (max. 48" AFF)	<input type="checkbox"/>	<input type="checkbox"/>
	Accessible shelves (40" – 48" AFF)	<input type="checkbox"/>	<input type="checkbox"/>
	Locker hardware operations (operable with one hand without tight pinching, twisting, or turning of wrist; max. 5# of force)	<input type="checkbox"/>	<input type="checkbox"/>
TOILET ROOMS	If provided, complete <b>TOILET ROOMS</b> section		
BATHTUB AND SHOWERS	If provided, complete <b>BATHTUB AND SHOWERS</b> section		