
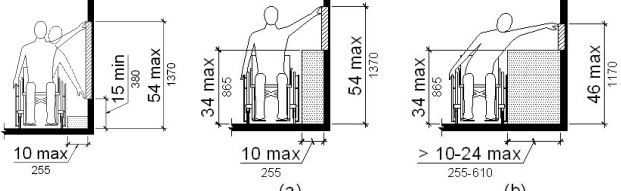


ELEMENT		COMPLIES (or NA)	DOES NOT COMPLY
<b>PLATFORM LIFTS</b>			
WHERE PERMITTED	<p>Platform lifts complying with state and local codes are permitted only under the following conditions:</p> <ol style="list-style-type: none"> <li>1. To provide an accessible route to a performing area in an assembly occupancy.</li> <li>2. To comply with wheelchair viewing position line-of-sight and dispersion requirements.</li> <li>3. To provide access to incidental spaces that house no more than 5 persons.</li> <li>4. To provide access where existing site constraints or other constraints make use of a ramp or elevator infeasible.</li> </ol>		
Accessible platform lifts may be used as part of an accessible route			
LIFT	Entrance (unassisted entry, operation, and exit, max. 1-1/4" gap at transition runway) (power-operated doors or gates are preferred)	<input type="checkbox"/>	<input type="checkbox"/>
Floor plan	Door clear opening (front 32", side 42" min.)	<input type="checkbox"/>	<input type="checkbox"/>
	Floor plan size (min. 30" x 48", firm, stable, slip-resistant)	<input type="checkbox"/>	<input type="checkbox"/>
			
	Floor surface (firm, stable, slip-resistant; carpet if provided, 1/2" max. pile, securely attached)	<input type="checkbox"/>	<input type="checkbox"/>
CONTROLS	Location (15"-48" AFF forward, 9"-54" AFF side reach)	<input type="checkbox"/>	<input type="checkbox"/>
			
	Control location (min. 30" x 48" clear floor area provided at reach range)	<input type="checkbox"/>	<input type="checkbox"/>
	Control operation (operable with one hand without tight pinching, twisting, or turning of wrist; max. 5# of force)	<input type="checkbox"/>	<input type="checkbox"/>