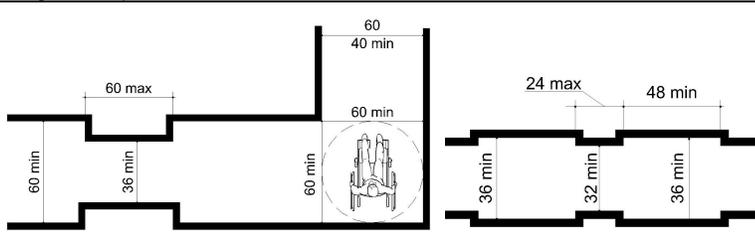


ELEMENT		COMPLIES (or NA)	DOES NOT COMPLY
PLAYGROUNDS			
APPLICABLE	New play areas and altered portions of existing play areas for children over the age of two shall comply with this section.		
EXCEPTION	<ol style="list-style-type: none"> 1. Play areas located in child care facilities where the proprietor resides are not required to comply. 2. Play components that are relocated in existing play areas for the purpose of creating safe use zones are not required to comply. 3. Where play components are altered and the ground surface is not altered, the ground surface is not required to comply with (ground surfaces). 4. This section does not apply to amusement attractions. 5. Compliance with protruding objects is not required within the boundary of the play. 6. Compliance with stairs is not required within the boundary of the play area. 		
GROUND LEVEL PLAY ELEMENT	Where provided, at least one of each type of ground level components shall be provided. Each ground component shall be on an accessible route and be linked to accessible play components. Where elevated play components are provided, ground level ground level components shall be also be provided.		
ELEVATED PLAY COMPONENT	At least 50% of the elevated play components shall be on an accessible route. Elevated play components connected by a ramp shall be accessible.		
ACCESSIBLE ROUTE	At least one accessible route, as modified by this section, shall be provided. Transfer systems shall be permitted to connect elevated play components.		
	Location (routes shall connect entry and exit points to play components, located within boundary of play area)	<input type="checkbox"/>	<input type="checkbox"/>
	Headroom (6'-8" min.)	<input type="checkbox"/>	<input type="checkbox"/>
	Width of Ground Route (60" min. for large playgrounds, 44" min. for small playgrounds where 60" turn is allowed at ends of route segments)	<input type="checkbox"/>	<input type="checkbox"/>
	Width of Elevated Route (36" min., 32" min. for max. 24" long segments)	<input type="checkbox"/>	<input type="checkbox"/>
	Route width	 <p>The diagram illustrates route width requirements. For ground routes, a minimum width of 60 inches is shown for a straight section, and a minimum of 36 inches is shown for a section with a 60-inch maximum width. For elevated routes, a minimum width of 60 inches is shown for a section with a 24-inch maximum length, and a minimum of 32 inches is shown for a section with a 48-inch maximum length. A small inset diagram shows a person's feet on a ramp with a 60-inch minimum width.</p>	
	Route slope (1:20 max. running slope)	<input type="checkbox"/>	<input type="checkbox"/>
RAMP	Clear width (36" min.)	<input type="checkbox"/>	<input type="checkbox"/>
	Ground level ramp slope (1:16 max. running slope)	<input type="checkbox"/>	<input type="checkbox"/>
	Elevated ramp slope linking play components (1:12 max. running slope)	<input type="checkbox"/>	<input type="checkbox"/>
	Ramp surface (firm, stable, slip-resistant; no abrupt changes > 1/4")	<input type="checkbox"/>	<input type="checkbox"/>
	Landings (min. width = to ramp width; 60" min. length; 60" x 60" min. if change in direction)	<input type="checkbox"/>	<input type="checkbox"/>
HANDRAILS	Handrails (required on both sides of ramp; extensions not required)	<input type="checkbox"/>	<input type="checkbox"/>
	Handrail height (28" - 30" above ramp surface)	<input type="checkbox"/>	<input type="checkbox"/>
	Handrail (1" - 1-1/2" diameter or equivalent gripping surface)	<input type="checkbox"/>	<input type="checkbox"/>
TRANSFER	Transfer platforms complying with this section shall be provided where		

ELEMENT		COMPLIES (or NA)	DOES NOT COMPLY
PLATFORM	transfer is intended to be from a wheelchair or other mobility device.		
	Transfer platform size (min. 14" deep x 24" long)	<input type="checkbox"/>	<input type="checkbox"/>
	Height (11" - 18" above ground or floor surface)	<input type="checkbox"/>	<input type="checkbox"/>
	Transfer space (clear and level, min. 24" x 48" parallel to the transfer platform, centered)	<input type="checkbox"/>	<input type="checkbox"/>
Transfer platform			
TRANSFER STEPS	Transfer steps shall be provided where movement is intended to be from a transfer platform to a level with an elevated play component that is located on an accessible route.		
	Transfer step size (min. 14" deep x 24" long)	<input type="checkbox"/>	<input type="checkbox"/>
	Height (max. 8" high riser)	<input type="checkbox"/>	<input type="checkbox"/>
Transfer step			
PLAY COMPONENTS	Ground level play components located on accessible routes and elevated components connected by ramps shall comply with this section.		
	Maneuvering area (on same level of play component, level, allows for 60" diameter or T-shaped turn)	<input type="checkbox"/>	<input type="checkbox"/>
	Clear ground space (min. 30" x 48" adjacent to play component)		
Clear ground space			
	Transfer height to entry point or seat (11" – 24" above the ground)	<input type="checkbox"/>	<input type="checkbox"/>
PLAY TABLES	Where provided for children over the age of 5, shall comply with the following:		
	Knee clearance (min. 24" high, 30" wide, 17" deep)	<input type="checkbox"/>	<input type="checkbox"/>
	Play table surface rim or surface height (31" max. AFF)	<input type="checkbox"/>	<input type="checkbox"/>
Play table			