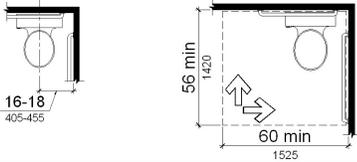
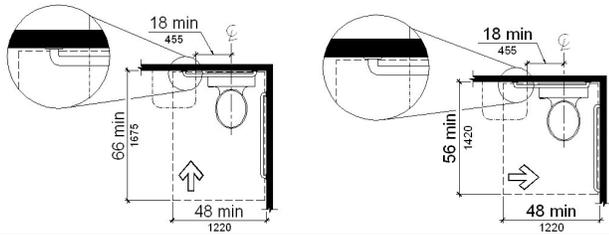
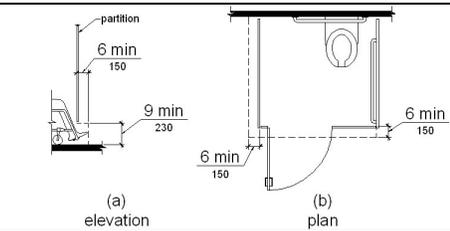
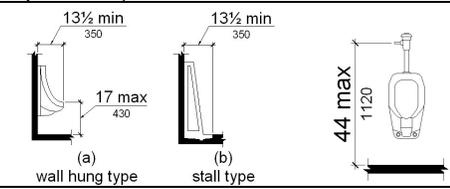
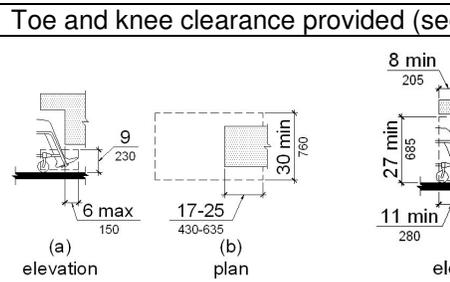
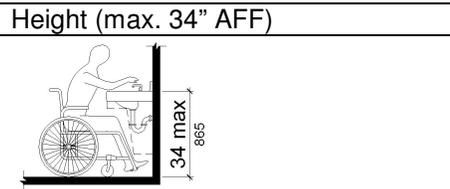
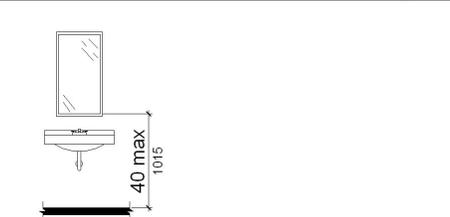


ELEMENT		COMPLIES (or NA)	DOES NOT COMPLY
<b>TOILET ROOMS</b>			
APPLICABLE	<p>If toilet facilities are provided, then each such public or common use toilet facility shall comply with this section. In addition, public and common use areas adjacent to and serving the toilet rooms shall comply with all other applicable accessibility sections of this checklist.</p> <p>Other toilet rooms provided for the specific use of occupants of specified spaces (e.g. private toilet serving a private office) shall be adaptable.</p> <p>Existing conditions: Where it is technically infeasible to comply with this section, the use of a unisex (family) toilet may be permitted. Check with local code officials to confirm.</p>		
ISA SIGN	Accessible toilet rooms (identified w/ the international symbol of accessibility when all are not accessible)	<input type="checkbox"/>	<input type="checkbox"/>
SIGNAGE	For room identification, complete <b>SIGNAGE</b> section		
DOOR	If provided, complete <b>DOOR</b> section		
ALARMS	If provided, complete <b>ALARMS</b> section		
TOILET RM	Shall be on an accessible route	<input type="checkbox"/>	<input type="checkbox"/>
	Clear floor space (60" diameter unobstructed circle required; may overlap door swing, clear floor space at fixtures)	<input type="checkbox"/>	<input type="checkbox"/>
	Door swing (shall not swing into clear floor space for any fixture)	<input type="checkbox"/>	<input type="checkbox"/>
APPLICABLE WATER CLOSETS	<p>If water closets are provided, a min. of 1 shall comply with this section.</p> <p>Clear floor space (18" from side wall) Note: New ADAAG graphic illustrated below.</p>	<input type="checkbox"/>	<input type="checkbox"/>
	Clear floor space (56" from back, 60" from side)	<input type="checkbox"/>	<input type="checkbox"/>
Clear floor space (fixtures not located in stalls)			
Clear floor space (residential exception)			
	Height (17"-19" AFF to top of seat)	<input type="checkbox"/>	<input type="checkbox"/>
GRAB BARS	Grab bars (33"-36" AFF to top; side wall min. 42" long, 12" from back wall; back wall min. 36" long, 12" min. on each side of water closet)	<input type="checkbox"/>	<input type="checkbox"/>

ELEMENT	COMPLIES (or NA)	DOES NOT COMPLY
Grab bars		
Size and Spacing (1-1/4 – 1-1/2” outside diameter; 1-1/2” from the wall)		
Strength (shall permit vertical or horizontal force of 250#)		
Flush controls (automatic; or max. 44” AFF, mounted wide side, easy operation)		
Dispenser (7” – 9” in front of water closet, 15” – 48” AFF to outlet, and shall not be located behind grab bar)		
Dispenser		
APPLICABLE	If stalls are provided, a min. of 1 shall be a “standard stall”.	
TOILET STALLS	If 6 or more stalls are provided, in addition to the standard stall, an “alternate stall” shall also be provided.	
Standard stall size (min. 60” wide; min. 56” deep for wall hung and min. 59” deep for floor mounted water closets)		
Alternate stall size (36” wide; min. 66” deep for wall hung and min. 69” deep for floor mounted water closets)		
Doors (min. 32” clear opening; located on opposite corner from water closet; accessible maneuvering areas; 42” min. for latch side approach)		
Door hardware (accessible latch; pull located on both sides)		
Standard Stall, Size and arrangement		
Toe Clearance (min. 9” AFF for front and one side wall, 6” beyond partition for typical stall)		

ELEMENT		COMPLIES (or NA)	DOES NOT COMPLY
<p>Toe clearance</p> 	<p>Coat hooks (max. 48" AFF)</p>	<input type="checkbox"/>	<input type="checkbox"/>
<p>APPLICABLE URINALS</p>	<p>If provided, a min. of 1 shall comply with this section</p>		
	<p>Clear floor area (min. 30" by 48" for a forward approach)</p>	<input type="checkbox"/>	<input type="checkbox"/>
	<p>Height (max. 17" AFF to top of rim)</p>	<input type="checkbox"/>	<input type="checkbox"/>
	<p>Depth (min. 13-1/2" deep)</p>	<input type="checkbox"/>	<input type="checkbox"/>
	<p>Flush controls (automatic; or max. 44" AFF, mounted wide side, easy operation)</p>	<input type="checkbox"/>	<input type="checkbox"/>
<p>Mounting height</p>			
<p>APPLICABLE LAVATORIES AND SINKS</p>	<p>If provided, a min. of 1 lavatory and 1 mirror shall comply with this section.</p>		
	<p>Clear floor area (min. 30" by 48" for a forward approach)</p>	<input type="checkbox"/>	<input type="checkbox"/>
	<p>Toe and knee clearance provided (see figs. below)</p>	<input type="checkbox"/>	<input type="checkbox"/>
<p>Toe and Knee Clearance</p>			
<p>Lavatory height</p>			
	<p>Faucets (automatic; or operable with one hand, no grasping or twisting of wrist to operate)</p>	<input type="checkbox"/>	<input type="checkbox"/>
	<p>Exposed Pipes and Surfaces (insulated or configured to avoid contact)</p>	<input type="checkbox"/>	<input type="checkbox"/>
<p>MIRRORS</p>	<p>Mirrors (max. 40" AFF to reflecting surface)</p>	<input type="checkbox"/>	<input type="checkbox"/>
<p>Mirror height</p>			

ELEMENT		COMPLIES (or NA)	DOES NOT COMPLY
Coat hooks (max. 48" AFF)		<input type="checkbox"/>	<input type="checkbox"/>
Shelves (40" – 48" AFF)		<input type="checkbox"/>	<input type="checkbox"/>
SOAP / TOWEL DISPENSER	Clear floor space (30" x 48" for forward or parallel approach)	<input type="checkbox"/>	<input type="checkbox"/>
	Reach range (48" AFF max. forward, 54" max. side)	<input type="checkbox"/>	<input type="checkbox"/>
Clear floor space/ Reach range			
Reach range	<p>Reach range over obstruction (&lt; 20" deep obstruction w/ knee space, 48" AFF max. forward; 20-25" deep obstruction w/ knee space, 44" AFF max. forward reach; &lt; 10" deep obstruction, 34" high obstruction, 54" max. side; 10-24" deep, 34" high obstruction, 46" AFF max. side reach)</p>	<input type="checkbox"/>	<input type="checkbox"/>
PROTRUDING OBJECTS	Protruding objects (if leading edge 27"-80" AFF, max. 4" projection to path of travel)	<input type="checkbox"/>	<input type="checkbox"/>
Protruding Objects			